

## Installation Instructions

### Model HCP

Intelligent Control Point

#### INTRODUCTION

The Model HCP Intelligent Control Point from Siemens Industry, Inc. provides remote, independent control of any of the following:

1. A notification appliance circuit (NAC)
2. A telephone zone (XLS only)
3. A speaker zone (25V or 70.7V RMS) (XLS only, FV2025/2050, FV922/924)

The HCP communicates through the DLC device loop card of the FireFinder-XLS System, the FS-DLC device loop card of the FS-250 System, the FC922/FV922, FC2025/FV2025 periphery FCI2016 Board (250p) detector circuits, and the FC2050/FV2050, FC924/FV924 FCI2017 periphery board (500p) detector circuits. Each HCP uses one device address on the device loop.

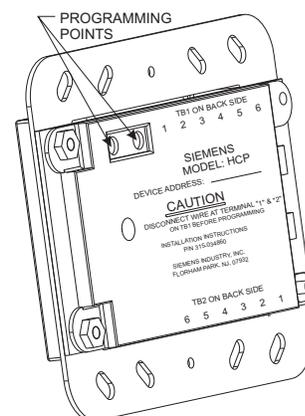


Figure 1  
HCP Intelligent Control Point

#### PROGRAMMING



Use the DPU Programmer/Tester to program and test the module.

The HCP may only be assigned addresses 1 to 60. It is recommended to program the HCP devices first to ensure that enough addresses have been reserved for them. Other devices may then be assigned to addresses in this range that were not assigned to an HCP.



Disconnect wire at terminal 1 and 2 on TB1 before programming.

To set the HCP device address:

- Plug the programming cable of the DPU Programmer/Tester into the two-pin programming points on the HCP. (See Figure 1 for location.)
- Set the device address for the HCP by following the instructions in the *DPU Programmer/Tester Manual*, P/N 315-033260.

Each HCP can be assigned a custom message using either the Zeus Programming Tool (XLS System), the FS-CT2 (FS-250 System), the FC2025/2050, FV2025/2050 FSX2002 Engineering Tool, or the FC922/924, FV922/924 FSX7212 Engineering Tool. Refer to the Zeus Quick Start Manual, P/N 315-033875, or the FS-250 Programming Manual, P/N 315-049403, as applicable.

---

## COMPATIBILITY

The following minimum revisions are required for proper operation of the HCP:

<b>XLS SYSTEM:</b>		<b>FS-250 SYSTEM:</b>		<b>FS20 SYSTEM</b>	
DLC	04.00.0000	FS-DLC	1.50	<i>DESIGO</i>	
PMI	04.00.0000	NAC	2.18	FC2025/2050	41.xx.xx
PSC-12	07.00.0000	PANEL	5.0	FV2025/2050	60.xx.xx
ZAC-40	02.08.0000				
	130.08.0000*				
ZEUS	04.00.0019			<i>CERBERUS PRO</i>	
				FC922/924	41.xx.xx
				FV922/924	60.xx.xx

\*ZAC-40 Rev. 02.09.0000/130.09.0000, Rev. 02.21.0000 and Rev. 02.24.0000 are NOT compatible with the HCP. Revert to Rev. 02.08.0000/130.08.0000 or Rev. 02.10.0000/130.10.0000.

---

## WIRING



Remove all system power before installation, first battery then AC. (To power up, connect the AC first, then the battery.)

Power down the 24 VDC power supply and the input source (ZAC, etc.) before installing the HCP.

All wiring must comply with national and local codes. All wire must be 18 AWG minimum, 12 AWG maximum.

### Device Loops

The HCP communicates with the FireFinder-XLS/FS-250/Desigo FC2025/2050, FV2025/2050/Cerberus PRO FC922/924, FV922/924 Systems through its addressable device loops. These loops are connected to the DLC via terminal blocks on the CC-5 or CC-2 cardcage (XLS) or to the FS-DLC via TB3 on the FS-MB/FS-MB2 main board (FS-250). They may be wired Class A (Style 6) or Class B (Style 4). Figure 2 shows both wiring types and the connections to the DLC. See the DLC Installation Instructions, P/N 315-033090, for more information. Figure 3 shows both wiring types and connections to the FS-DLC. See the FS-250 Installation, Operation and Maintenance Manual, P/N 315-049353, for more information. Figure 4 shows both wiring types and connections to the Periphery boards. See the Desigo FC2025/2050 FV2025/2050 Configuration Manual, Document ID A6V10315023, for more information. Figure 5 shows both wiring types and connections to the Periphery boards. See the Cerberus PRO FC922/924 FV922/924 Configuration Manual, Document ID A6V10333423, for more information.

### HCP Power Supply


For FireFinder-XLS Systems, compatible power supplies for the HCP are the PSC-12, PSX-12, and PAD-4. Wiring should be connected to TB3 on the PSC-12 and PSX-12, or the auxiliary power supply on the PAD-4.

For FS-250 Systems, the HCP is powered by the NAC circuits and PAD-4. Wiring should be connected to the NAC circuits on the main board or the auxiliary power supply on the PAD-4.

NOTES

1. Loop resistance 50 ohms  
Max with 252 devices on the loop. Refer to the DLC Installation Instructions, P/N 315-033090 if the number of devices is less than 252.
2. 12-18 AWG wire.
3. No EOL device required.
4. Supervised, power limited per NEC 760.
5. All wiring must conform to national and local electrical codes.

**CLASS A WIRING\***  
\*OPERATES IN FULL CONFORMANCE WITH STYLE 6 (ULC DCLA)  
NO T-TAPPING ALLOWED  
BOTH ZONES MUST BE WIRED AS CLASS A

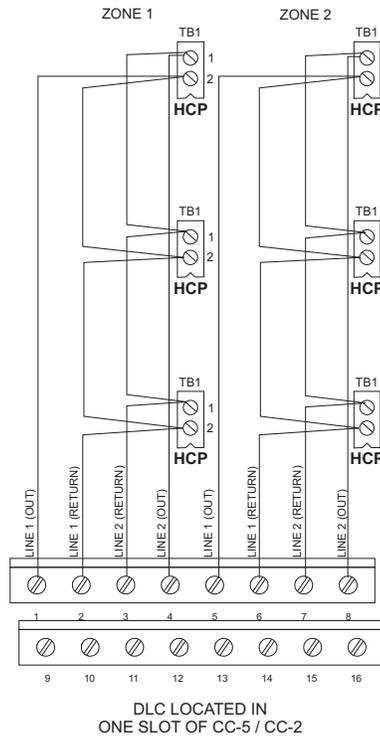

**CLASS B WIRING\*\***  
\*\*OPERATES IN FULL CONFORMANCE WITH STYLE 4 (ULC DCLB)  
T-TAPPING ALLOWED  
BOTH ZONES MUST BE WIRED AS CLASS B


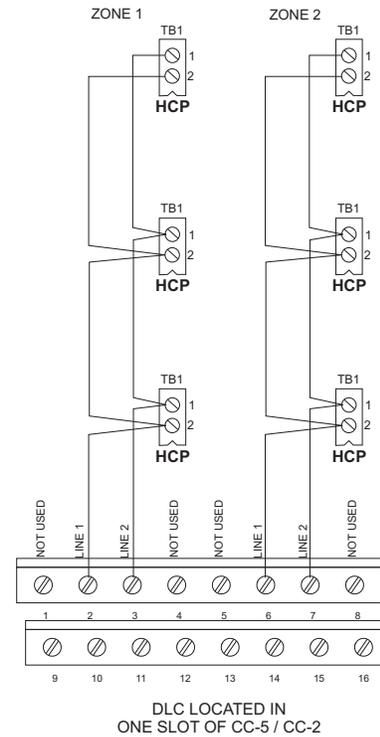


Figure 2  
FireFinder-XLS Device Loop Connections


NOTES

1. Loop resistance 180 ohms  
max with 252 devices on loop.
2. 12-18 AWG wire.
3. No EOL device required.
4. Supervised, power limited per NEC 760.
5. All wiring must conform to national and local electrical codes.

**CLASS A WIRING**

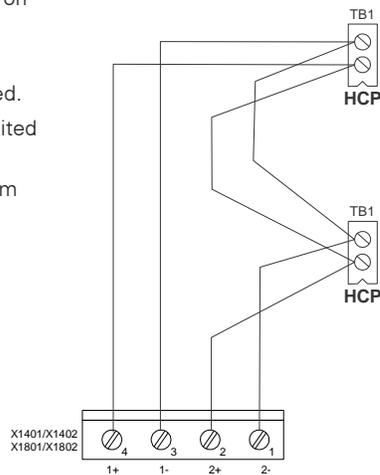

**CLASS B WIRING**

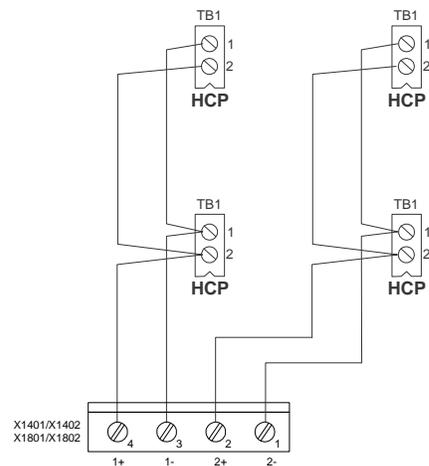

Detector circuits on periphery board for FC922/FV922, FC2025/FV2025

Figure 3  
FS20 Device Loop Connections

**NOTES**

1. Loop resistance 50 ohms Max with 252 devices on the loop. Refer to the FS-250 Manual, P/N 315-049353 if the number of devices is less than 252.
2. 12-18 AWG wire.
3. No EOL device required.
4. Supervised, power limited per NEC 760.
5. All wiring must conform to national and local electrical codes.

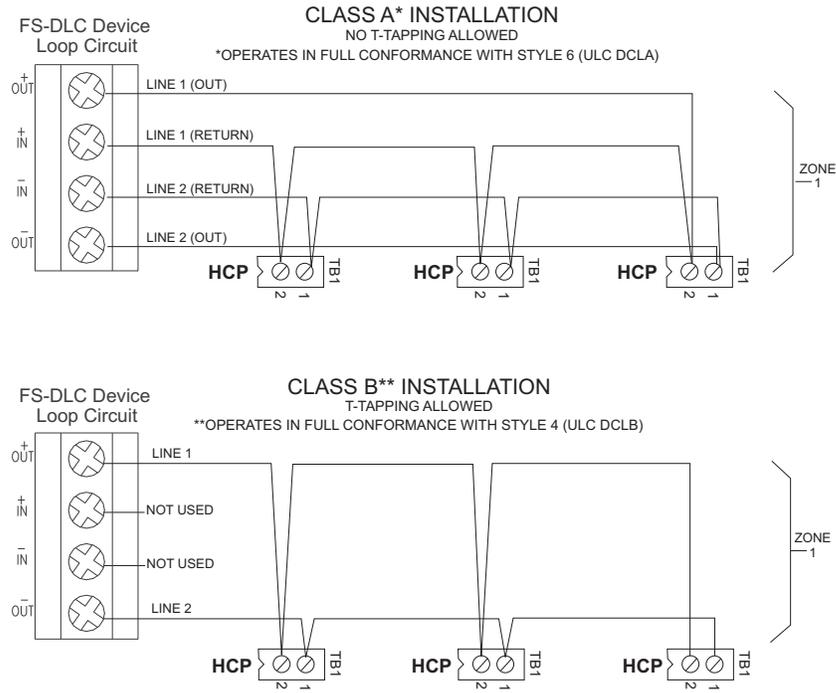


Figure 4  
FS-250 Device  
Loop Connections

**DPU Loop Test**

When performing a loop test with the DPU be sure to apply power to the HCP. Without power applied to the HCP a blinking "C" will appear on the DPU, indicating that the HCP is in trouble.

**HCP As NAC Module**

This application uses the principle of polarity reversal to activate notification appliances. Wiring is shown in Figure 4. Connect the HCP output zone wiring to the (+) and (-) terminals of each notification appliance as shown in Figure 4. For a list of compatible devices, refer to P/N 315-096363.

When used as a NAC module, the 24VDC provides power for the supervision circuitry and to the notification appliances when they are activated. The power source must be power limited. See the HCP Power Supply section (above) for compatible power sources. The maximum output load that may be connected to an HCP is 1.5A at 24 VDC. If the 24 VDC is lost or the NAC line is broken or shorted while the HCP is in supervisory mode, a trouble condition displays at the FireFinder-XLS, FS-250 System control panel, the Desigo FC2025/2050, FV2025/2050 Operating Unit, and the Cerberus PRO FC922/924, FV922/924 Operating Unit. For FS-250 Systems, the NAC circuit must be set to "always on" in the panel or FS-CT2 configuration tool. See the Line Resistance table below for the allowable line resistance for each HCP output circuit.

**MAXIMUM ALLOWABLE HCP OUTPUT CIRCUIT LINE RESISTANCE FOR SPECIFIED DC RISER CURRENT AND LINE RESISTANCE**

MAXIMUM DC RISER CURRENT (in Amps)	DC RISER RESISTANCE (in Ohms)					
	0.1 Ohm	0.25 Ohm	0.5 Ohm	0.75 Ohm	1 Ohm	1.5 Ohms
4	2.73	2.33	1.67	1.00	.33	—
3	2.80	2.50	2.00	1.50	1.00	—
2	2.86	2.67	2.33	2.00	1.67	1.00
1	2.93	2.83	2.67	2.50	2.33	2.00
.5	2.96	2.92	2.83	2.75	2.67	2.50
MAXIMUM LOOP RESISTANCE FOR EACH HCP ON RISER						
NOTES:						
1. Resistances specified are for both wires.						
2. If the total current requirement exceeds 4A, local auxiliary 24 VDC supplies that are UL listed for fire protection signaling use, such as Siemens PAD-4, may be used.						

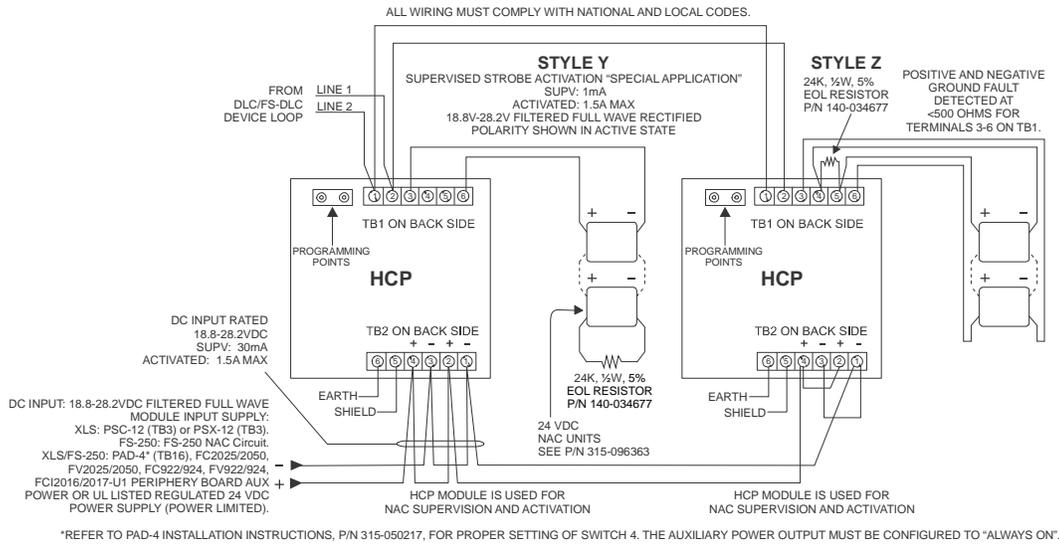


Figure 5  
HCP Used As An NAC Module

**NOTE** The input power and NAC power inputs on TB2 (1-4) must be connected to the same source.

**NOTE** All HCPs connected to a given DLC/FS-DLC circuit must reside within a single notification zone.

### HCP As Telephone Zone

When the HCP is used as a telephone zone module (FireFinder-XLS System only) as shown in Figure 5, the 24 VDC provides power to the supervision and call-in detection circuitry. If the 24 VDC is lost, a trouble condition displays on the PMI/PMI-2 of the FireFinder-XLS.

The HCP provides a dial tone when a Fireman's Master telephone (FMT) is taken off hook or when a Portable FireFighter's telephone (PFT) is jacked in.

**NOTE**

Each HCP can support a maximum of 5 phones off hook. Throughout the system, no more than 10 phones may be off hook at any one time.

The supervised telephone common talk riser starts at the TZC-8B module in the CAB backbox. The common talk riser connects continuously to each HCP with a 10K end of line device at the last HCP. Tie the shield of these riser wires together using terminal 5 of TB2 and isolate them from the system circuits and the earth ground.

**NOTE**

Individual phones may not be connected to a riser that is wired to HCPs. The TZC-8B zone must be configured for Riser usage in Zeus.

Connect the supervised telephone zone wiring to the HCP with twisted pair cable. Terminate at the last station with a 75K ohm end of line resistor. As with the common talk line described in the paragraph above, be sure that the shield is continuous and isolated from both system circuits and earth ground and that the shields are connected together using terminal 5 of TB-2.



HCP As (70.7V/25V) Speaker Zone in a FV2025/FV2050 or FV922/FV924 System

The 70.7V/25V RMS audio input to the HCP must be power limited, such as from the VCI2001-U1 Amplifier Card. The VCI2001-U1 supervises the audio connection path to the HCP and provides up to 50 watts of power. The VCI2001-U1 can be wired Style Y (Class B) or Style Z (Class A). Refer to the VCI2001-U1 Installation Instructions, Document ID A6V10370410, for further information. In order to function properly during degrade mode, the periphery FCI2016/2017-U1 to which the HCP is connected must be located in the same enclosure as the FDNET and VCI2001-U1 that supply audio to the HCP.

When the HCP is used as a speaker zone, the output speaker lines are only supervised when the zone is not active. The audio output must not be allowed to exceed 25 watts. The approximate decibel loss for the total speaker zone wire length for various wire gauge sizes is shown in Figure 7 for the 70.7V option and in Figure 8 for the 25V option. Connect the speaker output as Style Z (Class A) or Style Y (Class B) as shown in Figures 10 and 11.

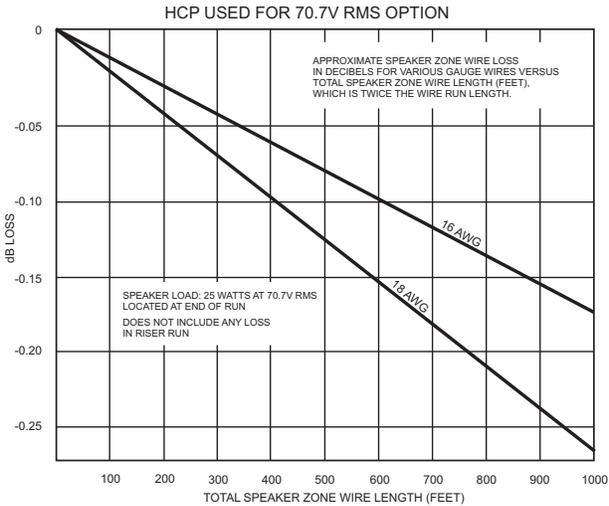


Figure 7  
Approximate Speaker Zone Wire Loss — 70.7V Option

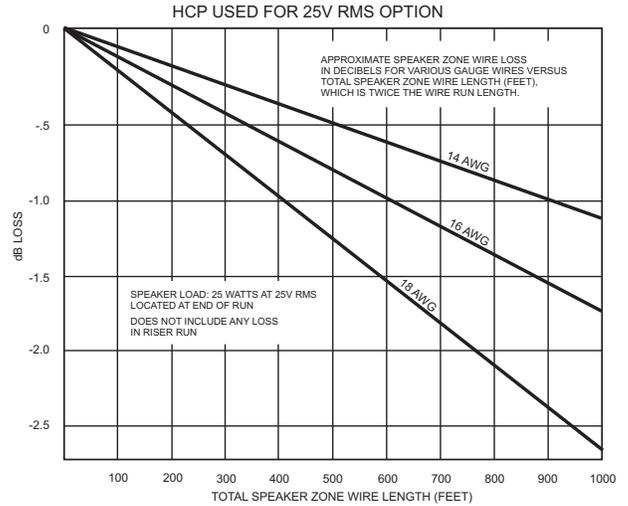


Figure 8  
Approximate Speaker Zone Wire Loss — 25V Option

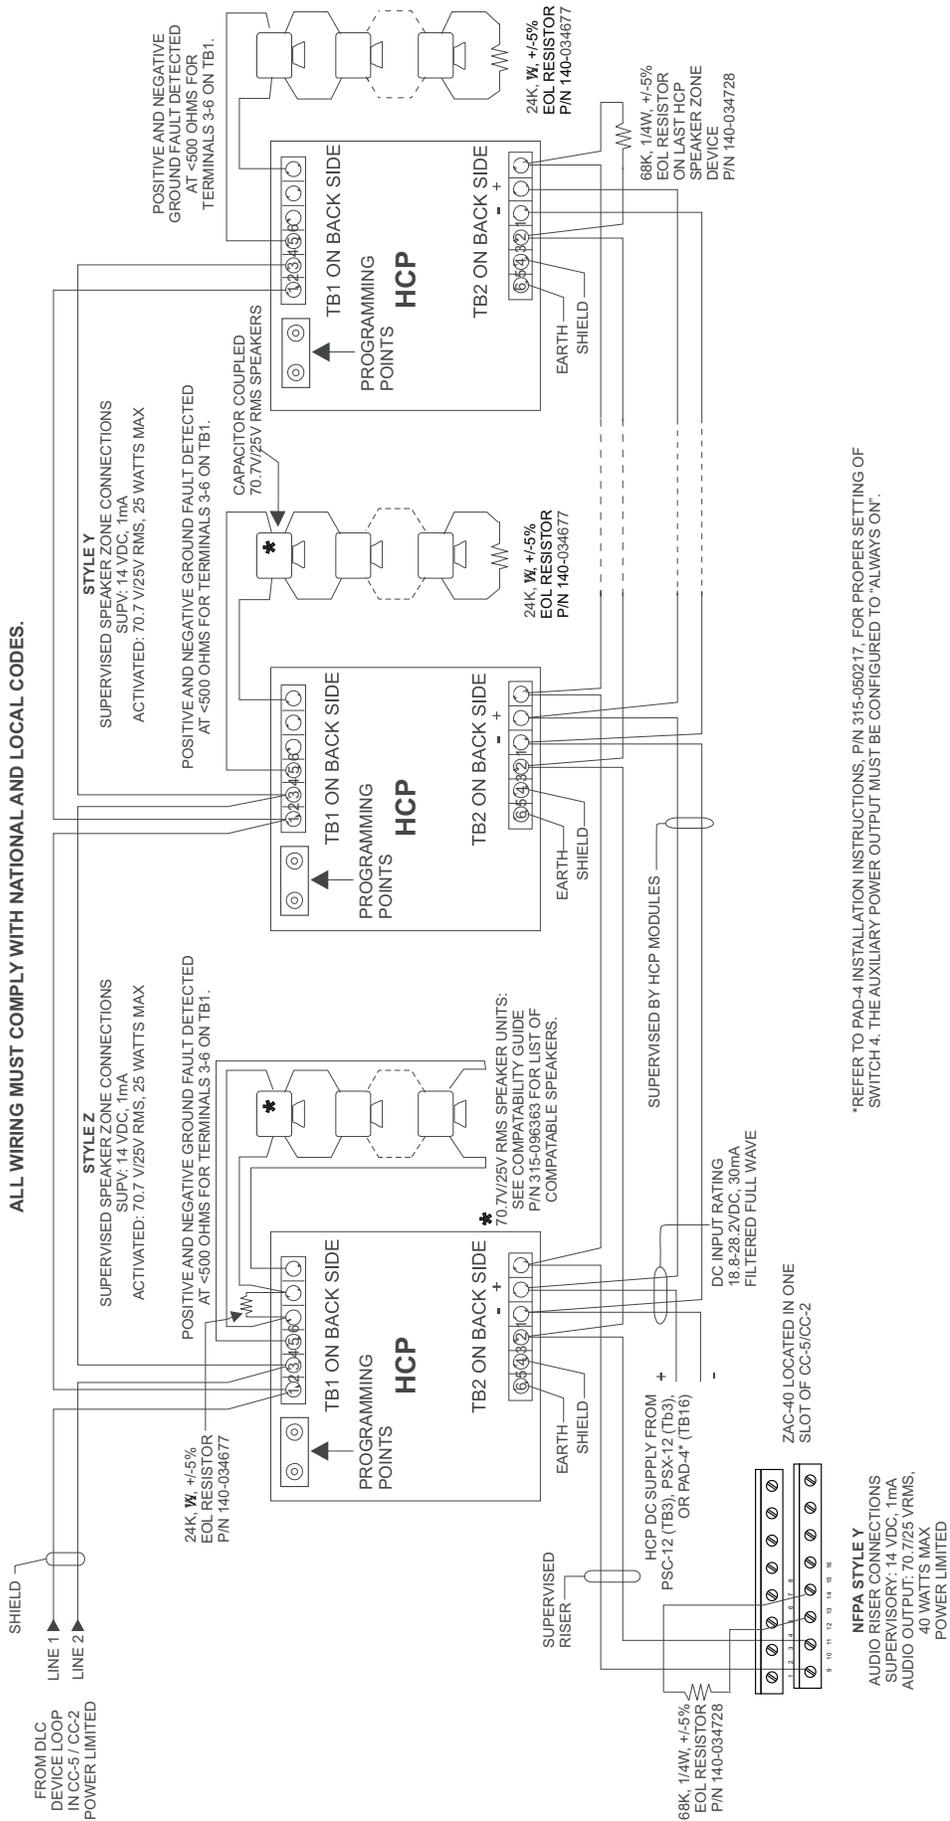


Figure 9  
HCP Used On An XLSV As A 70.7V/25V Speaker Zone





Mounting

**NOTE** 

Be sure to program the HCP before mounting the unit to the switchbox. (Refer to PROGRAMMING on page 1.)

**NOTE** 

The HCP should be installed in a UL listed electrical box. (See Figure 12.)

1. Use a standard 3 1/2-inch deep, double gang electrical switchbox or a 4-inch square electrical box that is 2 1/8 inches deep with either a 1 1/2-inch deep extension or a 1 1/4-inch deep plaster ring extension.
2. Connect the field wiring.
3. Insert the HCP into the box and fasten the device plate to the box.
4. Cover the device front plate with the 5-inch switchplate (supplied) and fasten with two plate screws.

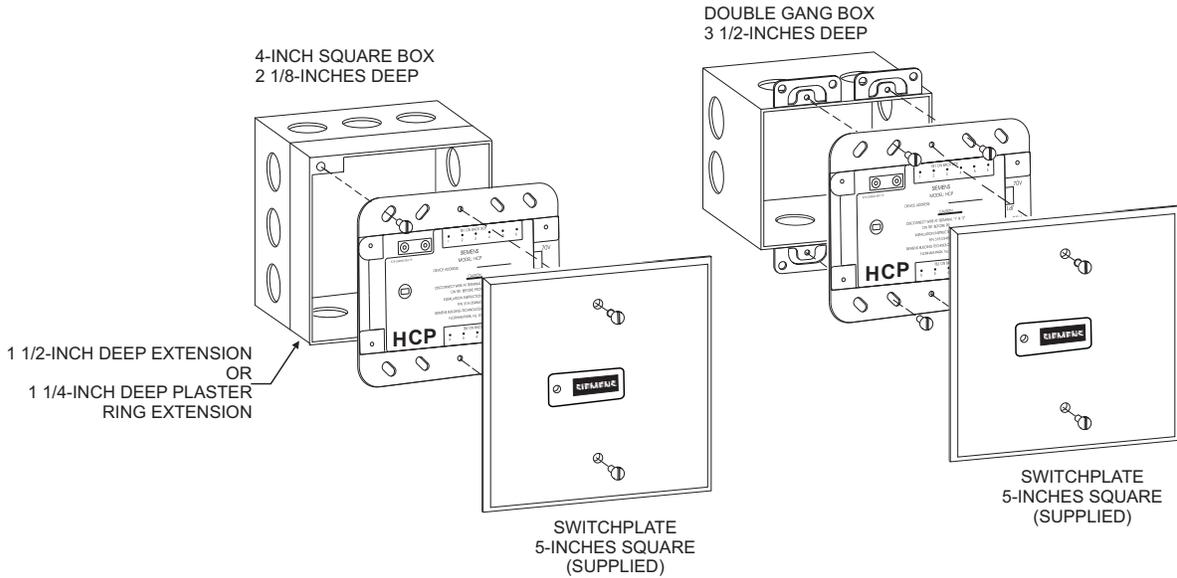


Figure 12  
Mounting The HCP

ELECTRICAL RATINGS

24VDC Power	
Voltage Range	18.8-28.2VDC
Max. Current	30mA
DLC / FS-DLC Loop	
Max. Current	1mA

## Cyber security disclaimer

Siemens products and solutions provide security functions to ensure the secure operation of building comfort, fire safety, security management and physical security systems. The security functions on these products and solutions are important components of a comprehensive security concept.

It is, however, necessary to implement and maintain a comprehensive, state-of-the-art security concept that is customized to individual security needs. Such a security concept may result in additional site-specific preventive action to ensure that the building comfort, fire safety, security management or physical security system for your site are operated in a secure manner. These measures may include, but are not limited to, separating networks, physically protecting system components, user awareness programs, defense in depth, etc.

For additional information on building technology security and our offerings, contact your Siemens sales or project department. We strongly recommend customers to follow our security advisories, which provide information on the latest security threats, patches and other mitigation measures.

<http://www.siemens.com/cert/en/cert-security-advisories.htm>