

**Features****Individually addressed and controlled multi-candela V/O (visible only) notification appliances provide:**


- Amber lens with “ALERT” lettering produces a signal unique from clear lens fire alarm evacuation strobes for use with Emergency Communications Systems
- Multi-candela xenon strobe with synchronized 1 Hz flash rate and with intensity *programmable from the control panel* or jumper selected as 15, 30, 75, or 110 cd
- Advanced addressable notification controlled by **IDNAC SLCs** from Simplex® 4100ES fire alarm control panels with EPS/EPS+ power supplies (and 4009 IDNAC Repeaters) providing **regulated 29 VRMS** allowing strobes to operate with lower current even under battery backup
- Separate device type allows connection on same SLC as clear lens strobes with independent operation; clear strobes for Fire Alarm, amber strobes for Alert (Operation is clear/Fire **OR** amber/Alert, **not both**)
- Wiring supervision to each strobe allowing “T-tapped” connections for Class B circuits to simplify wiring (Class A circuits require in/out wiring)
- **TrueAlert Device Reports** at the control panel detailing appliance point ID, custom label, type, and candela setting (see sample on page 3)
- **Magnet test diagnostics** to assist checkout and testing of appliances and wiring
- Compatibility with ADA requirements; (refer to important installation information on page 3)
- Compatibility with legacy TrueAlert addressable systems for upgrade and replacement (see page 4)
- UL listed to Standard 1638 (due to non-white lens); verified by UL testing to provide light dispersion patterns of UL Standard 1971 at rated candela (no derating necessary for amber lens)
- ULC listed to Standard S526

**LED indicator and magnet test feature:**

- Appliance LED can be selected to display each polling cycle to indicate appliance supervision
- In diagnostic mode, the magnet test pulses the LED to indicate appliance address **AND pulses to indicate the intensity selection**; a brief output of the strobe is also selectable to confirm operation

**Mechanical design features:**

- Rugged, high impact, flame retardant thermoplastic white housing
- Rear of housing does not extend into box and easily mounts to standard electrical boxes
- Options include box adapters and red wire guards

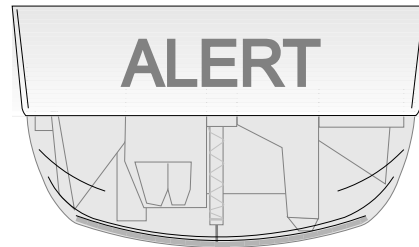

Ceiling Mount Addressable Amber Lens V/Os

**Description**

**Multi-Candela TrueAlert addressable amber lens strobes** provide convenient installation to standard electrical boxes. The strobe is individually addressed and individually controlled with power, supervision, and control supplied from a Simplex fire alarm control panel providing **IDNAC Signaling Line Circuits (SLCs)**. (See compatibility list on page 4.)

These amber lens multi-candela strobes provide non-fire alarm alert notification for use with Emergency Communications systems where additional response information is provided by audio or textual appliances.

**Strobe Application Reference**

Amber strobes used as part of an Emergency Communications system are located to provide the same area coverage as required of clear lens fire alarm strobes. Specific Emergency Communications requirements are discussed in detail in document UFC 4-021-01 (USA Department of Defense, United Facilities Criteria) and in NFPA 72, Chapter 24 (2010 and 2013 editions).

Proper strobe coverage criteria is further described in the *National Fire Alarm Code (NFPA 72)*, ANSI A117.1; the appropriate model building code: BOCA, ICBO, or SBCCI; and the application guidelines of the Americans with Disabilities Act (ADA).

\* See page 2 for wire guard listings. This product has been approved by the California State Fire Marshal (CSFM) pursuant to Section 13144.1 of the California Health and Safety Code. See CSFM Listing 7300-0026:325 for allowable values and/or conditions concerning material presented in this document. FM approval and MEA acceptance are not applicable. Additional listings may be applicable; contact your local Simplex product supplier for the latest status. Listings and approvals under Simplex Time Recorder Co. are the property of Tyco Fire Protection Products.

## IDNAC SLC Operation Advantage

**TrueAlert V/O Appliances with Addressable Amber Strobes on IDNAC SLCs** provide visible notification using a single two-wire circuit that also *confirms connection to the individual notification appliance's electronic circuit*. This operation increases circuit supervision integrity by providing supervision that extends beyond the appliance wiring connections.

**Reduced current allows efficient IDNAC SLC operation.** With *IDNAC SLCs*, a *constant 29 VRMS* source voltage is maintained, even during battery standby, allowing strobes to operate at higher voltage with lower current and ensuring a consistent current draw and voltage drop margin under both primary power and secondary battery standby. Efficiencies include wiring distances up to 2 to 3 times farther than with conventional notification, or support for more appliances per IDNAC SLC, or use of smaller gauge wiring, or combinations of these benefits, all providing installation and maintenance savings with high assurance that appliances that operate during normal system testing will operate during worst case alarm conditions.

**Reducing Installation and Testing Time.** With separate controls on the same two-wire SLC, installation time and expense for both retrofit and new construction can be significantly reduced. When Class B wiring is used, *wiring can be "T" tapped*, allowing more savings in distance, wire, conduit (size and utilization), and overall installation efficiency. Use of the magnet test feature improves installation efficiency. TrueAlert device reports conveniently identify information about each connected appliance.

## TrueAlert Addressable Diagnostics

**Test Features.** Controllers can be selected to pulse each appliance's LED when it receives a supervision poll. When the controller is selected for diagnostic mode, the appliance magnet test feature provides a response at the individual appliance being tested.

**Silent Appliance Magnet Test.** In this test mode, in response to the magnet test, the appliance LED pulses sequentially to conveniently indicate the appliance's address.

**Operational Appliance Testing.** In this test mode, after the address is indicated by pulsing the appliance LED, the strobe will briefly flash to indicate proper operation.

**TrueStart Instrument Two (TSIT).** The 2nd generation of the Simplex TrueStart Test Instrument adds testing of IDNAC SLC wiring and TrueAlert (and TrueAlert ES) appliances to its ability to test IDCs, NACs, and IDNet communications *before connection to the control panel*. Please contact your local Simplex representative for additional information.

## TrueAlert Addressable Wiring Isolator

**Isolator Model 4905-9929** is available for remote mounting on TrueAlert addressable circuits to isolate short circuited wiring from functioning wiring. (Refer to data sheet S4905-0001 for additional information.)

## Product Selection

### Multi-Candela Addressable Strobe with Amber Lens

Model	Description	Dimensions
4906-9207	Multi-Candela Addressable Ceiling Mount Strobe, white with red "ALERT" lettering with amber lens; intensity selectable as: 15, 30, 75, or 110 candela	4 3/4" x 2 5/16" x 2 5/8" D (121 mm x 75 mm x 67 mm)

### V/O Adapter and Wire Guard


Model	Description	Dimensions
4905-9910	Surface Mount Adapter Plate, zinc plated; <b>required for ceiling surface mount boxes</b>	4 7/8" x 3 1/8" (124 mm x 79 mm)
4905-9926*	Ceiling Mount red wire guard with mounting plate, compatible with semi-flush or surface mounted boxes (see diagram on page 3)	6 1/8" x 4 3/8" x 2 7/8" (156 mm x 111 mm x 73 mm)

\* UL listed by Space Age Electronics Inc.

## TrueAlert Device Reports Reference

POINT ID		CUSTOM LABEL	DEVICE TYPE	CANDELA
T14-1-1		Location Label . . . up to 40 characters	V/O	15
T14-1-2		Break Room 5	A/V	110
T14-1-3		Boiler Room Fire	A/V	75
T14-1-4		Boiler Room Alert	AMB	75

## Ceiling Mount V/O and Guard Installation Reference

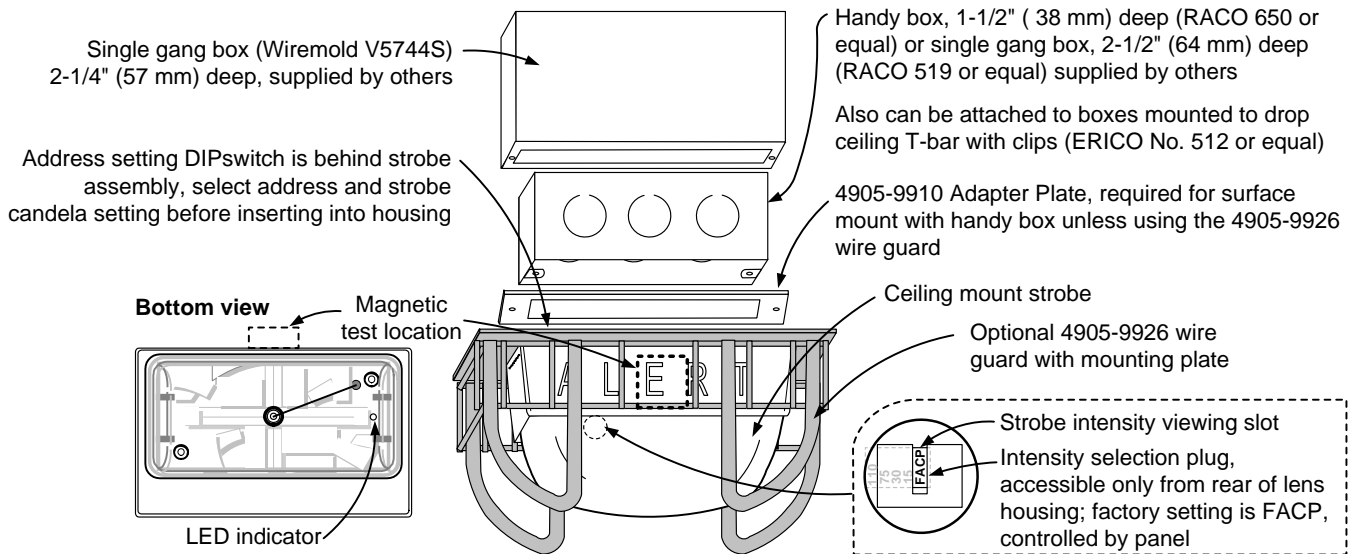

## TrueAlert Amber Strobe and IDNAC SLC Controller Compatibility Reference

Compatible Controller	Data Sheet Reference	Controller Output	IDNAC SLC Output Voltage	Appliance Voltage Design Reference
4100ES with EPS+ or EPS Power Supply	S4100-0100	IDNAC SLC	29 VRMS (regulated)	23 VRMS (with 6 VRMS drop)
4009 IDNAC Repeater	S4009-0004			

## Specifications

### Common Specifications (see page 2 for appliance dimensions)

Environmental	32° to 122° F (0° to 50° C); 10% to 93%, non-condensing at 100° F (38° C)
Connections	Terminal blocks for 18 AWG to 12 AWG (0.82 mm <sup>2</sup> to 3.31 mm <sup>2</sup> ); two wires per terminal for in/out wiring
Installation Instructions	579-828

### Strobe Specifications

Typical Operating Voltage Range	23 VRMS to 31 VRMS, Special Application (see below for 17 VRMS rating)				
Flash Rate and Synchronized SLC Loading	1 Hz; with up to 46 synchronized strobes maximum per NAC; maximum 30 Ω resistance between appliances				
<b>23 VRMS</b> Current Ratings, for connection to IDNAC Addressable SLCs	<b>Candela Setting</b>	<b>15 cd</b>	<b>30 cd</b>	<b>75 cd</b>	<b>110 cd</b>
		60 mA	92 mA	180 mA	240 mA

## TrueAlert Strobe LEGACY Compatibility Reference

Compatible Controller	Data Sheet Reference	Controller Output	Available Strobe Intensity	Appliance Voltage Minimum
4100ES or 4100U with TrueAlert Power Supply	S4100-0031	TrueAlert Addressable SLC	15, 30, 75, and 110 cd	<u>17 VRMS</u>
4009 TPS, Remote TrueAlert Power Supply	S4100-0037			
TrueAlert Addressable Controller (4009T)	S4009-0003			

### Electrical Ratings Difference for Retrofit Applications

	Voltage Range	17 VRMS to 31 VRMS, Special Application			
<b>17 VRMS</b> Current Ratings, use when connected to TrueAlert Addressable SLCs per above	<b>Candela Setting</b>	<b>15 cd</b>	<b>30 cd</b>	<b>75 cd</b>	<b>110 cd</b>
		76 mA	128 mA	242 mA	328 mA

*TYCO, SIMPLEX, and the product names listed in this material are marks and/or registered marks. Unauthorized use is strictly prohibited. NFPA 72 and National Fire Alarm Code are trademarks of the National Fire Protection Association (NFPA).*



Tyco Fire Protection Products • Westminster, MA • 01441-0001 • USA  
[www.simplex-fire.com](http://www.simplex-fire.com)

S4906-0007-7 8/2014

© 2014 Tyco Fire Protection Products. All rights reserved. All specifications and other information shown were current as of document revision date and are subject to change without notice.